


INDICATOR REFERENCE

POWER ON 1

POWER OFF O

DEHUMID. *



DEFROST V

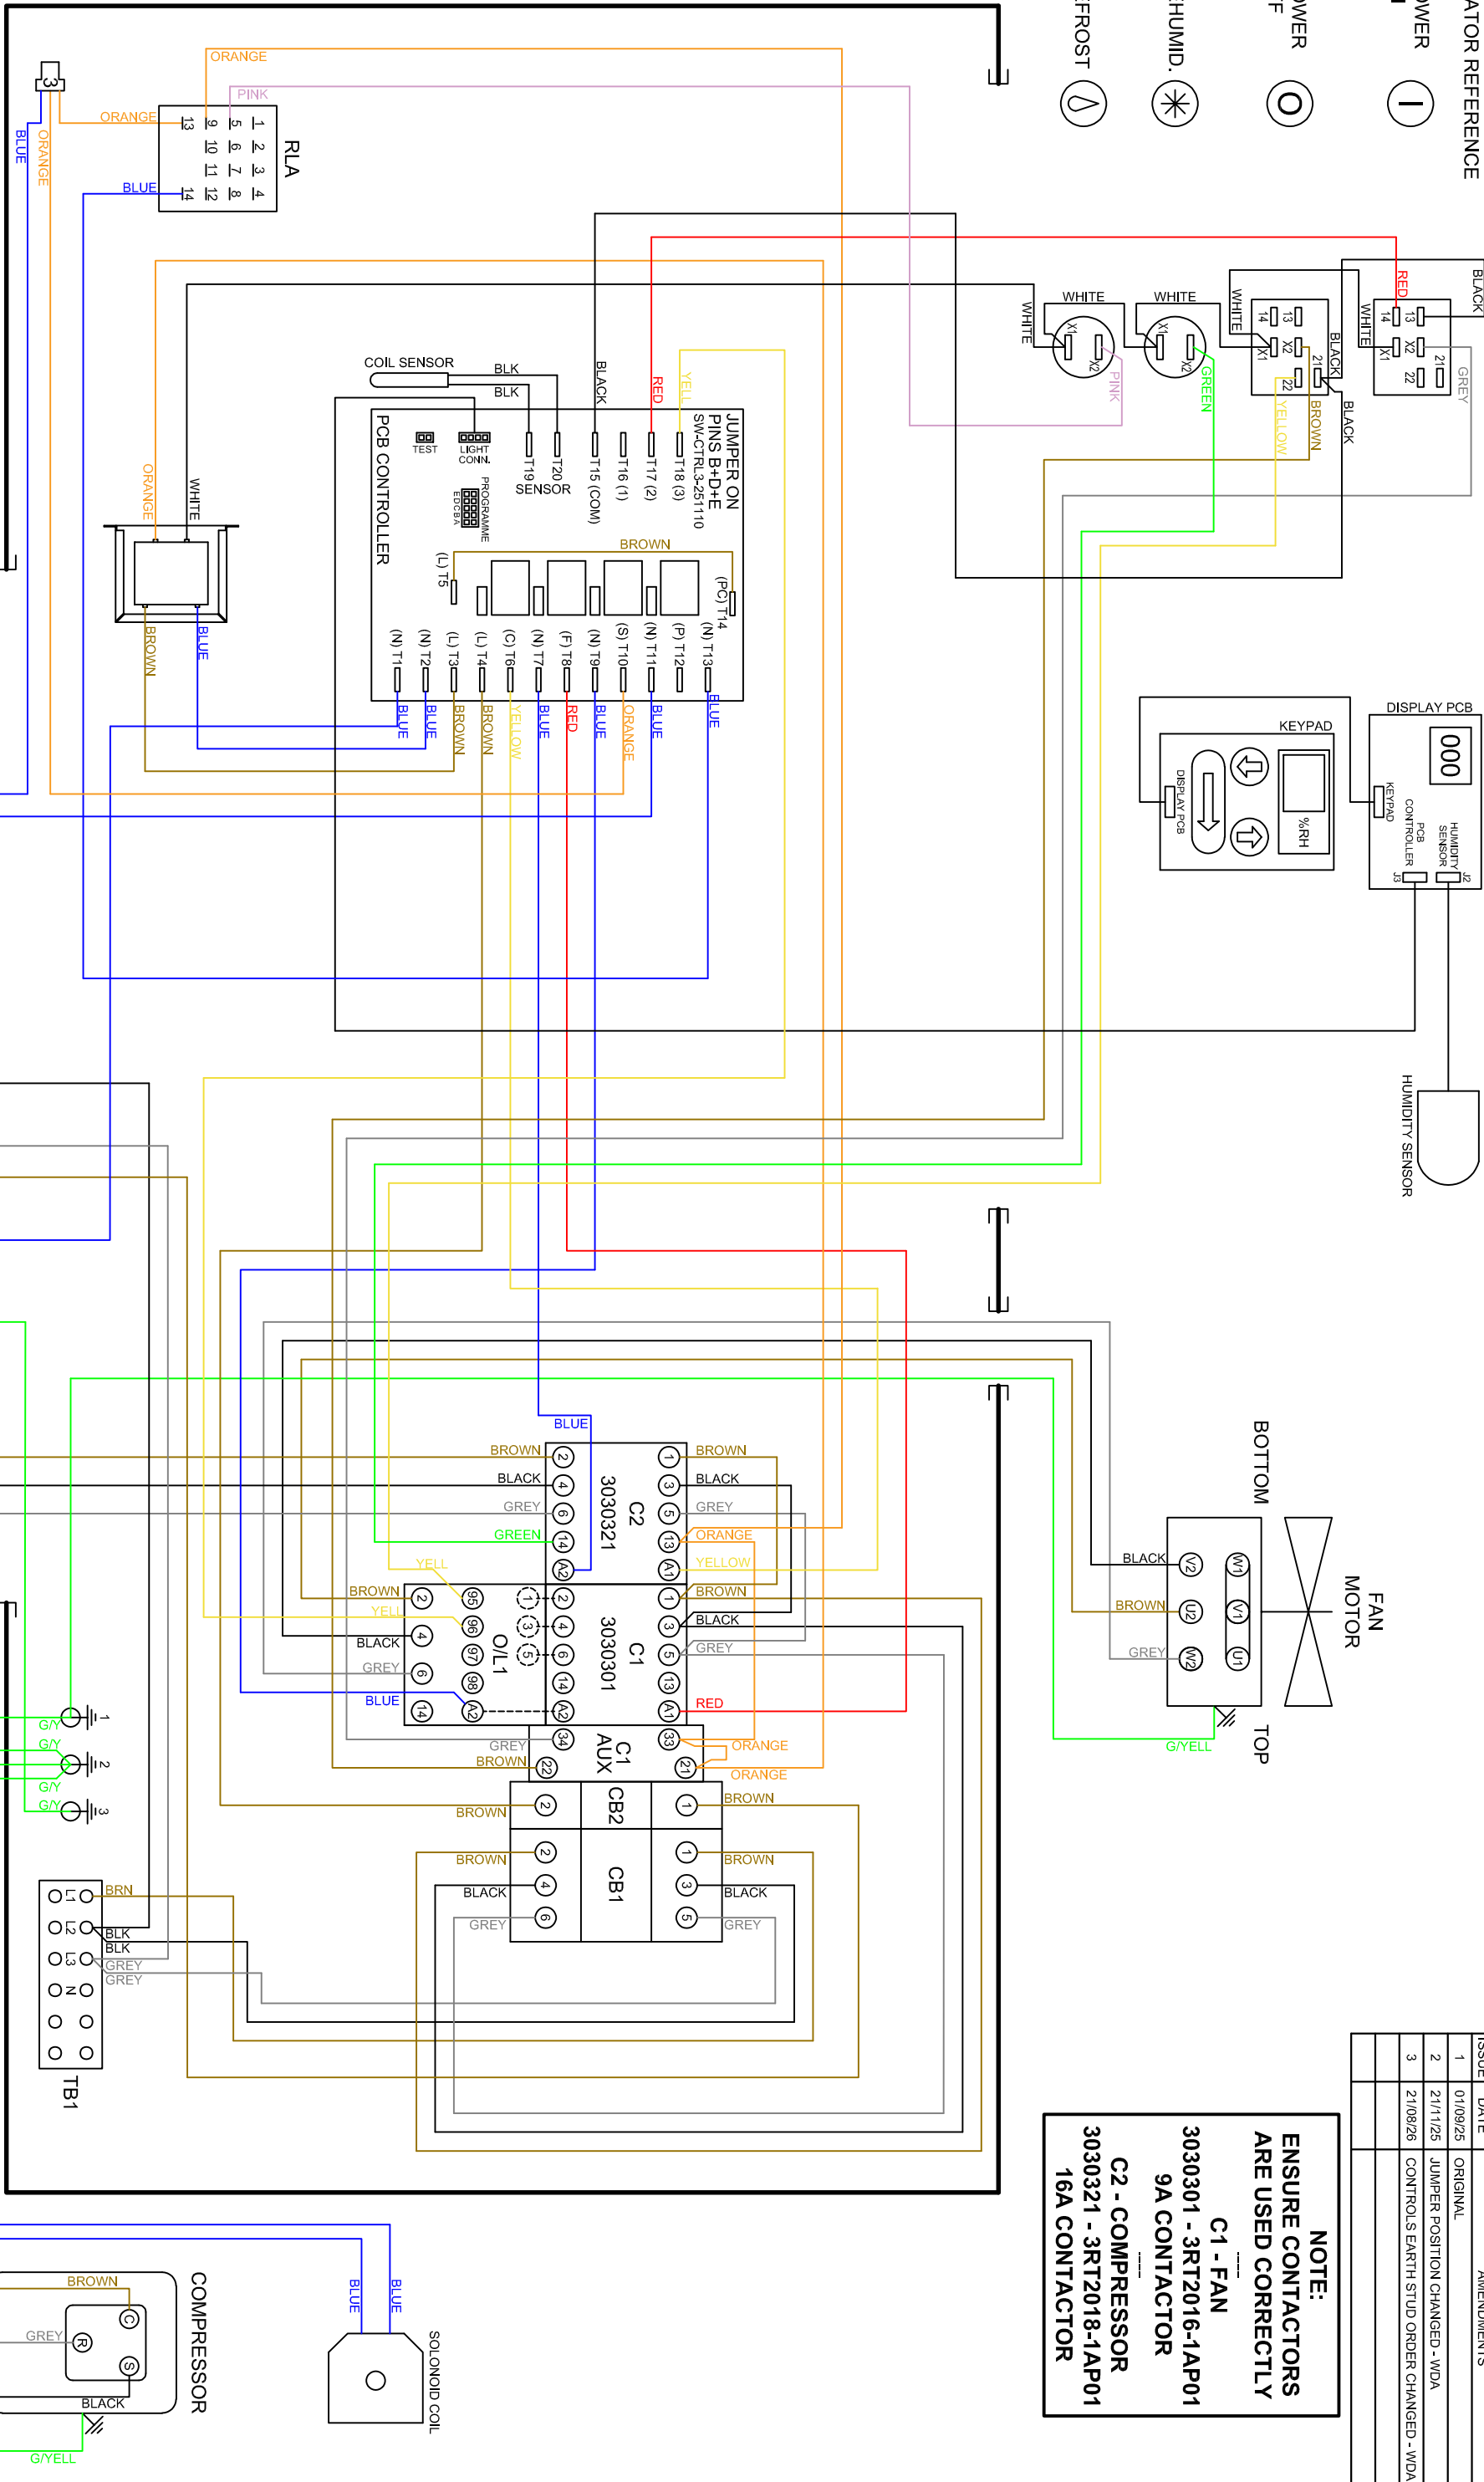

NOTE:
ENSURE CONTACTORS
ARE USED CORRECTLY

C1 - FAN
3030301 - 3RT2016-1AP01
9A CONTACTOR

C2 - COMPRESSOR
3030321 - 3RT2018-1AP01
16A CONTACTOR

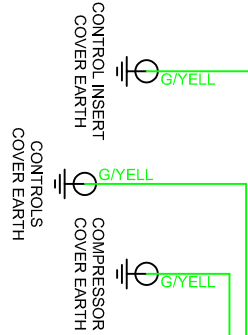

1997
BISHOP AUCKLAND
Co. DURHAM
ENGLAND

3RD ANGLE PROJECTION

DO NOT SCALE
IF IN DOUBT ASK

0. 0.00
0.05 0.05
ANGULAR 0.5 DEGREE

TITLE

CD425 460V / 3PH / 60Hz

MATERIAL

N/A

FINISH

N/A

DRAWN : W DAGLISH

CAD SCALE : 1/1

DRG. NO.

5010606

SHEET

1 OF 1

ISSUE	DATE	AMENDMENTS
1	01/09/25	ORIGINAL
2	21/11/25	JUMPER POSITION CHANGED - WDA
3	21/08/26	CONTROLS EARTH STUD ORDER CHANGED - WDA